


TTD™ Display Head (NEMA 4 Faceplate)

Configurable Fault Annunciator

Dimensions

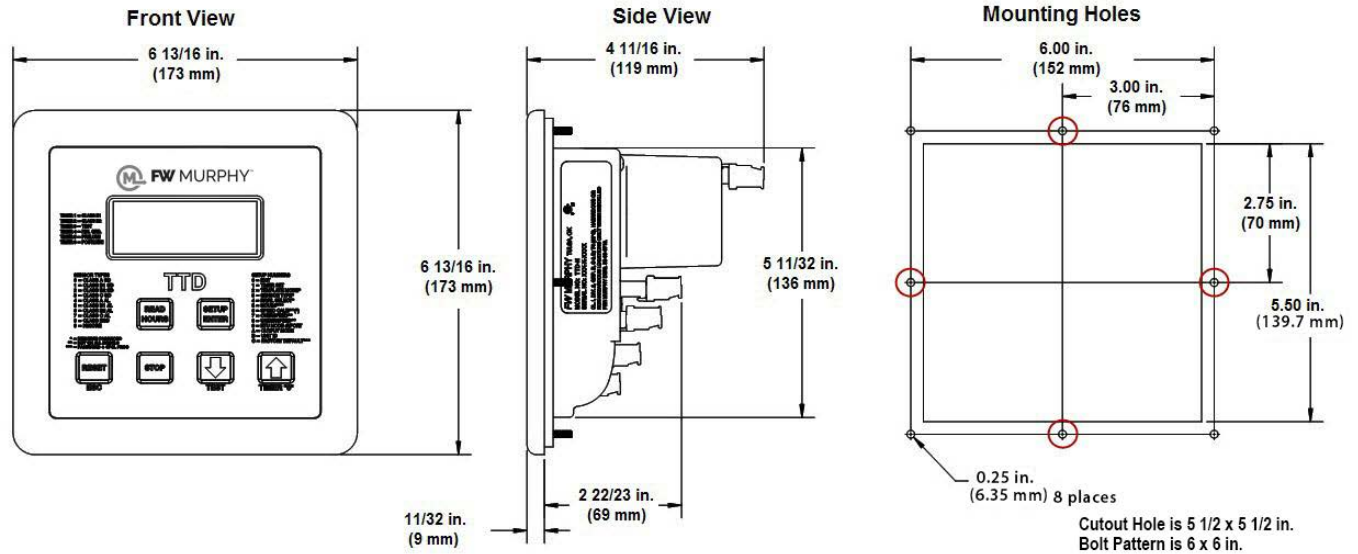

Special Considerations

- When installed per FW Murphy installation instructions, this TTD faceplate allows mounting through an enclosure to maintain NEMA 4 rating.
- The hole cutout above is a tighter dimensional requirement for the NEMA 4 rating. Existing holes may be larger and could void the gasket/surface requirement for a NEMA 4 rating.
- Installation of the NEMA 4 TTD will not necessarily change the NEMA rating of your control panel. The control panel enclosure must be rated for NEMA 4 applications.
- Mounting studs for the locations circled above can be removed (if necessary) when replacing the original designed bezel for the TTD (not NEMA rated). If replacing the original designed TTD head, be aware that the removal of these studs will VOID any NEMA 4 capabilities of the replacement Display.
- Removal of studs (if necessary) will NOT void any warranty.
- Stud tightening pattern should be followed as stated: Top left corner, Bottom right corner, Top right corner, Bottom left corner, Top center, Bottom center, Right center, Left center.
- Tighten holding nuts to 9 in. / lbs.

FW MURPHY PRODUCTION CONTROLS
SALES, SERVICES & ACCOUNTING
4646 S. HARVARD AVE.
TULSA, OK 74135

CONTROL SYSTEMS & SERVICES
2151 RANDON DYER ROAD
ROSENBERG, TX 77471

MANUFACTURING
5757 FARINON DRIVE
SAN ANTONIO, TX 78249

DOMESTIC SALES & SUPPORT
FW MURPHY PRODUCTS
PHONE: 918 957 1000
EMAIL: INFO@FWMURPHY.COM
WWW.FWMURPHY.COM

FW MURPHY CONTROL SYSTEMS & SERVICES
PHONE: 281 633 4500
EMAIL: CSS-SOLUTIONS@FWMURPHY.COM

INTERNATIONAL SALES & SUPPORT
CHINA
PHONE: +86 571 8788 6060
EMAIL: INTERNATIONAL@FWMURPHY.COM

LATIN AMERICA & CARIBBEAN
PHONE: +1 918 770 8775
EMAIL: INTERNATIONAL@FWMURPHY.COM

SOUTH KOREA
PHONE: +82 70 7951 4100
EMAIL: INTERNATIONAL@FWMURPHY.COM



FM 668576 (San Antonio, TX - USA)
FM 668933 (Rosenberg, TX - USA)



FM 523851 (China) TS 589322 (China)